COMPATIBLE UNIT DESIGNATION

MHRR0606RMY

2-2-1141.1.1

REINFORCING SCHEDULE								
LOCATION	6' X 6' PRECAST ROOF							
DEPTH	9"							
ROD NO.	1	2	3	4	5	6	7	8
QUANTITY	10	10	10	16	8	4	8	10
SIZE	#6	#6	#6	#3	#3	#3	#3	#6
LENGTH	1'-4"	6'-3"	6'-9"	2'-0"	6'-9"	1'-4"	6'-3"	1'-7"

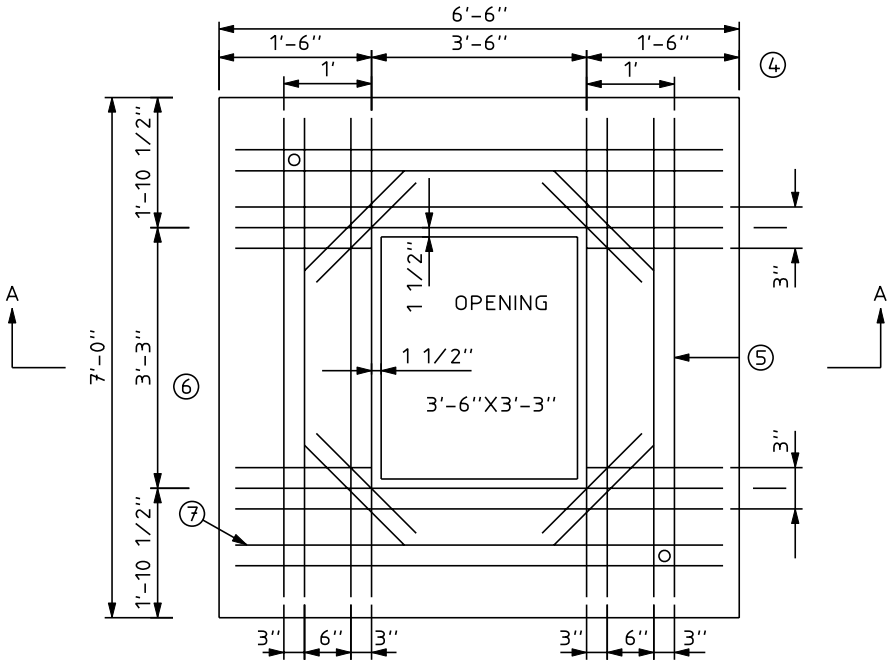

PLAN OF TOP REINFORCING

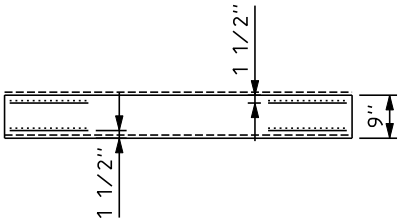

SECTION A-A

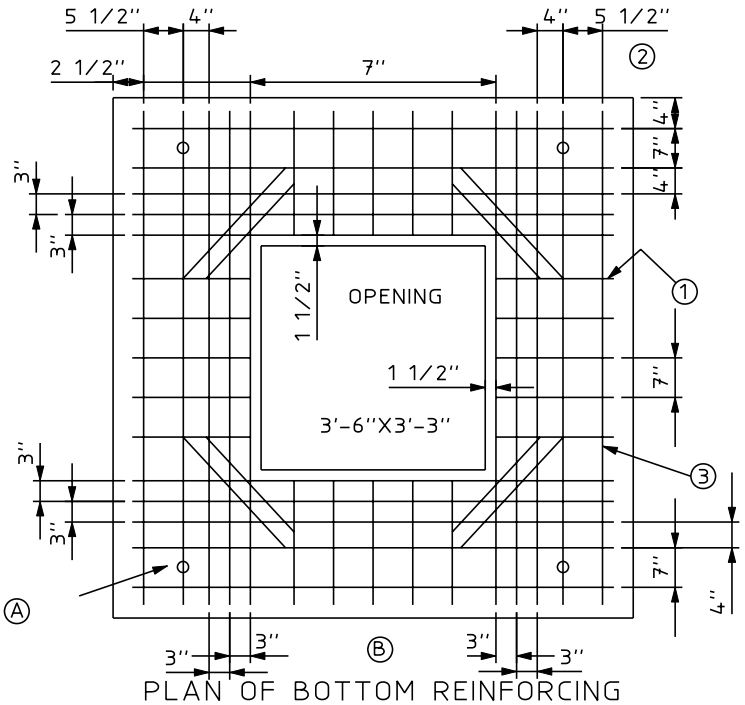

PLAN OF BOTTOM REINFORCING

Ⓐ INSTALL SUPERIOR SINGLE PICK-UP INSERTS-TYPE 1,4 REQUIRED.

NOTES:

1. TOTAL WEIGHT - 4200 LBS
   TOTAL CONCRETE - 1.1 CUBIC YD.
   6 BAG MIX, 3500 PSI AT 28 DAYS.
2. STOCK # 9721-0564
3. ROOF TO BE INSTALL WITH 12" MINIMUM COVER.
4. POSITION ROOF WITH 3'-6" OPENING DIMENSION IN DIRECTION OF TRAFFIC
5. REV A: CHANGED DWG FORMAT; CHANGED STOCK NO'S PER WMIS.

DRAWN: AIPL	DVLPED: CEG DATE: 4/23/79	REVIEWED: TDY DATE: 10/2/08	APPRVD: MDW DATE: 10/9/08	NEXT REVIEW: 11/11	REV: A

PHI PEPCO

POWER DISTRIBUTION STANDARDS

PRECAST ROADWAY ROOF FOR 6' X 6' MANHOLE