


PLAN VIEW

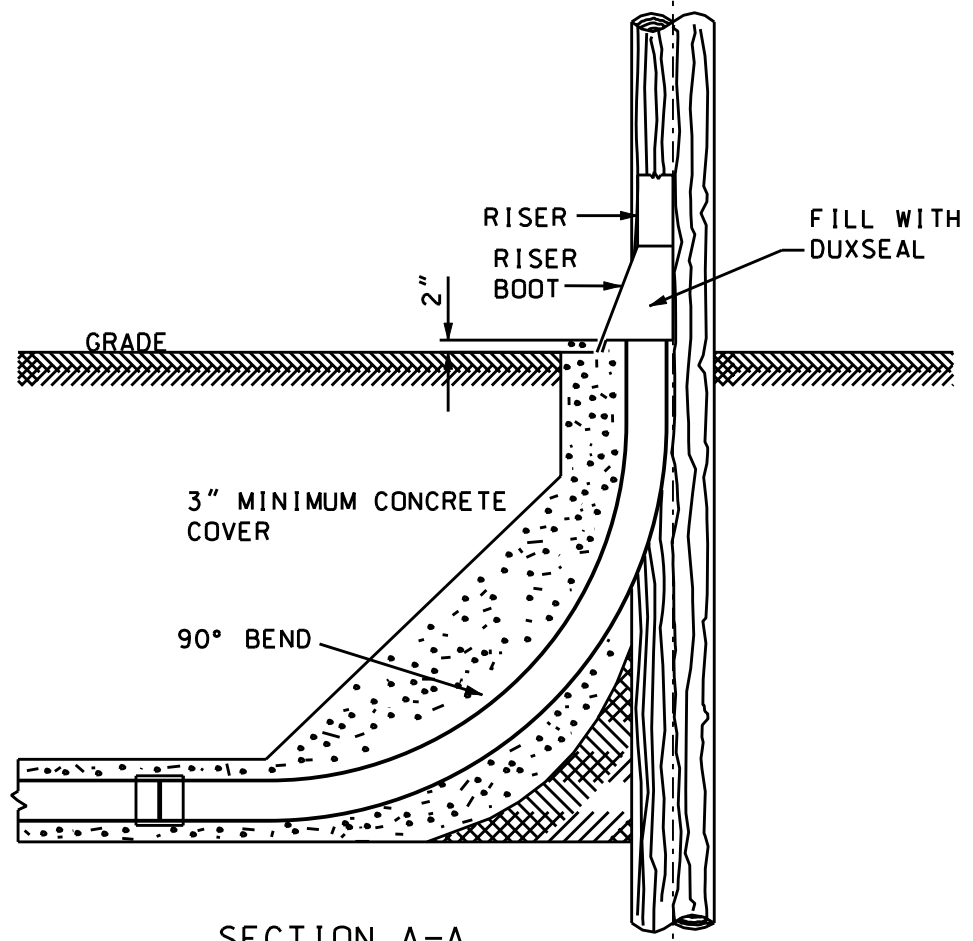

SECTION A-A

NOTES:


- 1. CONDUIT DEPARTMENT WILL PLUG DUCT IF RISER IS NOT INSTALLED IMMEDIATELY.
- 2. CUSTOMER OR CUSTOMER CONTRACTOR EXCAVATING WITHIN FIVE FEET OF A PEPCO OWNED POLE SHALL PERFORM THE WORK UNDER PEPCO SUPERVISION.
- 3. SEE PAGE 2 FOR ACCEPTABLE SWEEP BEND INSTALLATION.

DRAWN: DPJ	DVLPED: TC	DATE: 9-1-61	REVIEWED: ANA DATE: 9-11-08	APPRVD: MDW DATE: 10-1-08	NEXT REVIEW: 10-11	REV: B
------------	------------	--------------	-----------------------------	---------------------------	--------------------	--------



POWER  
DISTRIBUTION  
STANDARDS

POLE RISER SHIELD U.G. TO O.H.  
CONNECTION ASSEMBLY CONSTRUCTION

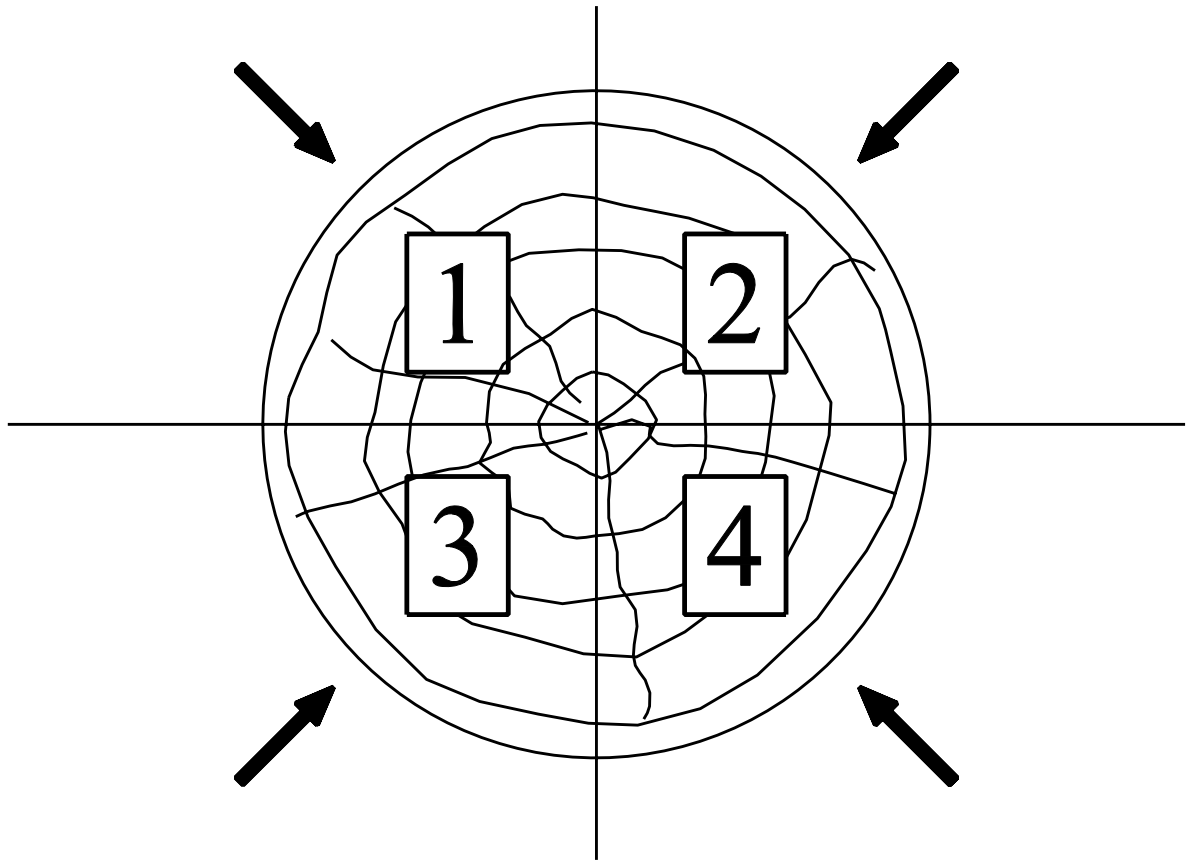

---

ROAD

<<<<< Traffic Direction

---

DRAWN: DPJ | DVLPED: TC | DATE: 9-1-61 | REVIEWED: ANA DATE: 9-11-08 | APPRVD: MDW DATE: 10-1-08 | NEXT REVIEW: 10-11 | REV: B



POWER  
DISTRIBUTION  
STANDARDS

OVERHEAD REFERENCE FOR  
SWEEP BEND INSTALLATION