

TYPICAL 265/460 VOLT 200 AMPERE OR LESS
SINGLE METER INSTALLATION


TROUGH SHALL HAVE KNOCK OUT FOR 2 1/2" CONNECTOR

CONNECTOR FOR 2 1/2" CONDUIT BY PEPCO

2 1/2" CONDUIT FURNISHED AND INSTALLED BY PEPCO

INCOMING SERVICE CABLES WILL BE FURNISHED AND INSTALLED BY PEPCO UP TO THE LINE SIDE CONNECTIONS OF THE SERVICE SWITCH

ALL EQUIPMENT WHICH IS NOT NOTED AS BEING FURNISHED AND/OR INSTALLED BY PEPCO WILL BE THE RESPONSIBILITY OF THE CUSTOMER TO FURNISH AND/OR INSTALL

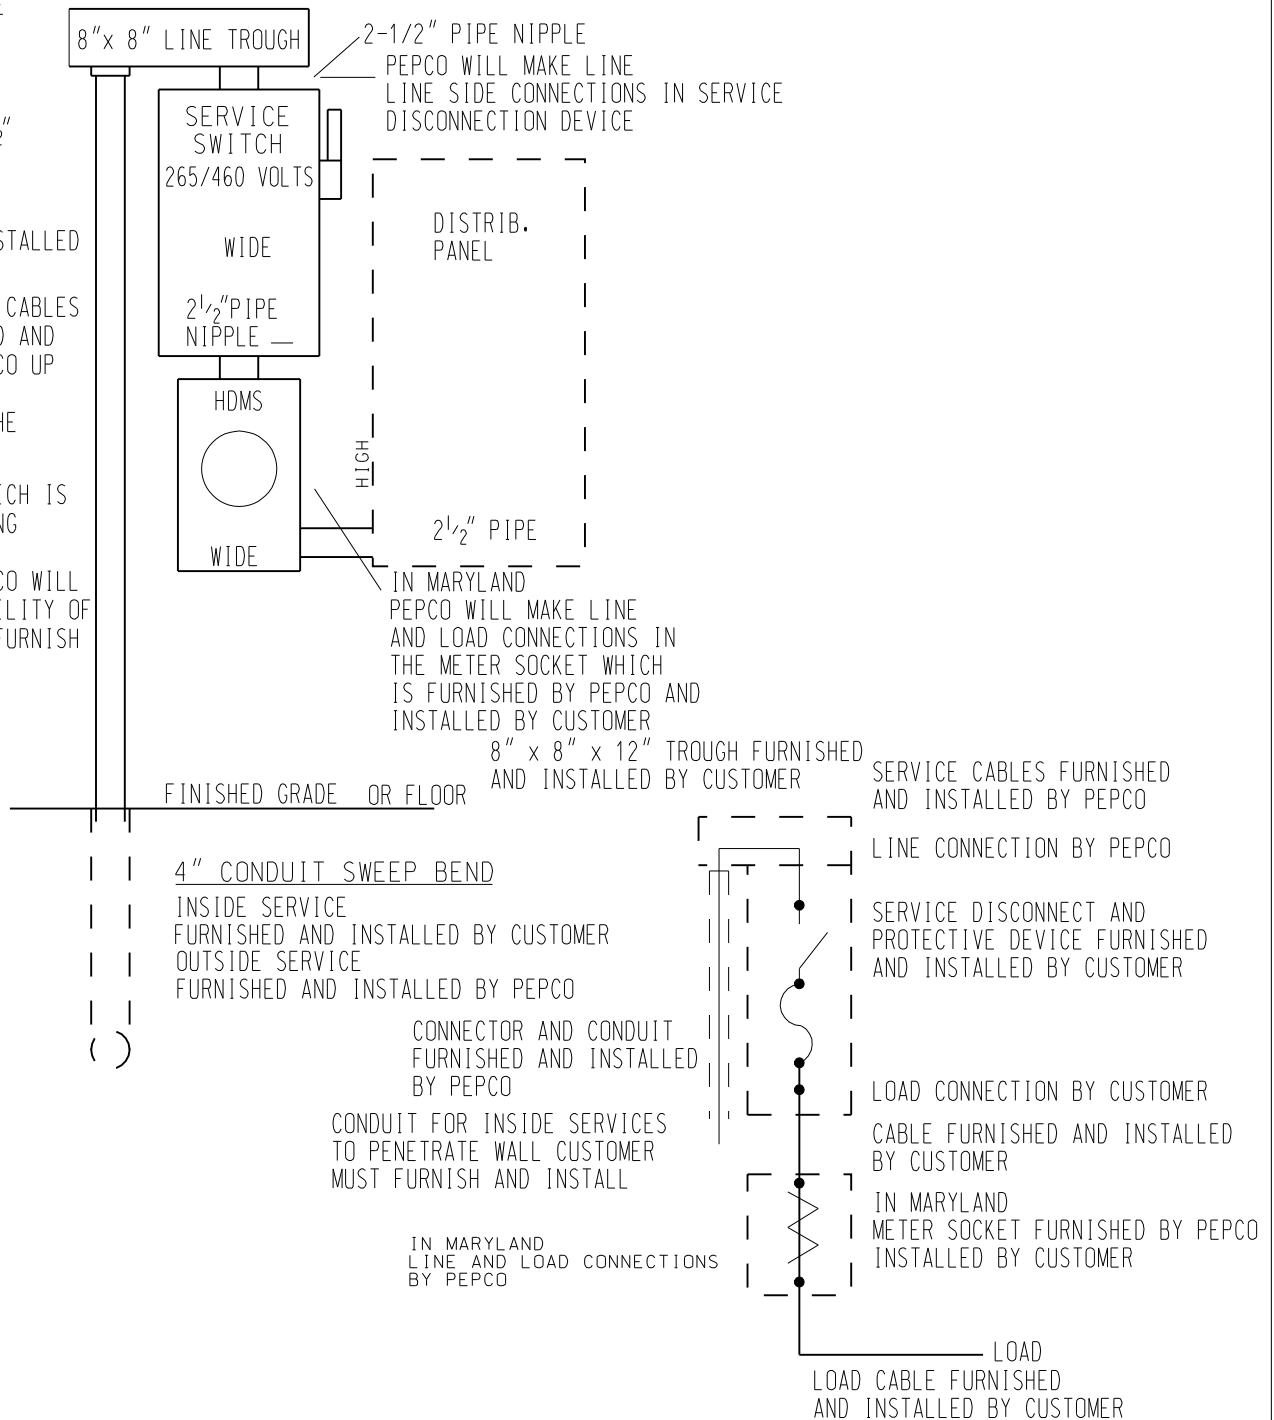

REFERENCES

ITEMS COVERED

NOTES

METER INSTALLATION FOR 265/460 VOLT 200 AMPERE OR LESS

1. SEE CD.005.11 FOR ALTERNATIVE CABLE CONNECTION.

REV.	CHANGE	APP'D	TITLE	METER INSTALLATION 265/460 VOLT	PREP.	DATE	04/26/82	DESIGN NO.
			CONSUMER DESIGN			BY	B. A. M.	CD.003.01
					APPROVED			SHT. NO. 1 OF 1
					J.D.S.	G.L.K.		