
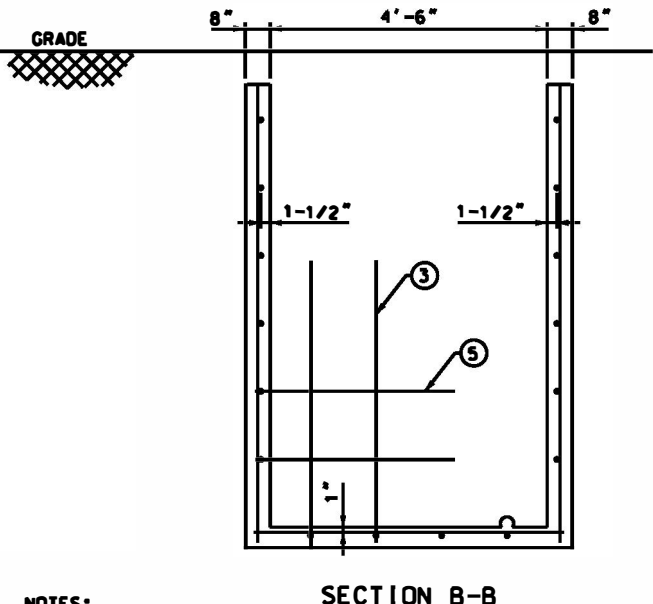
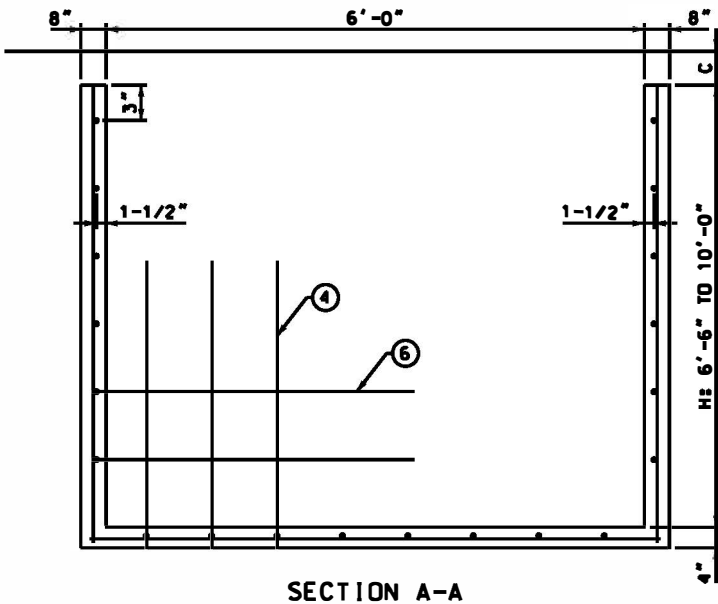
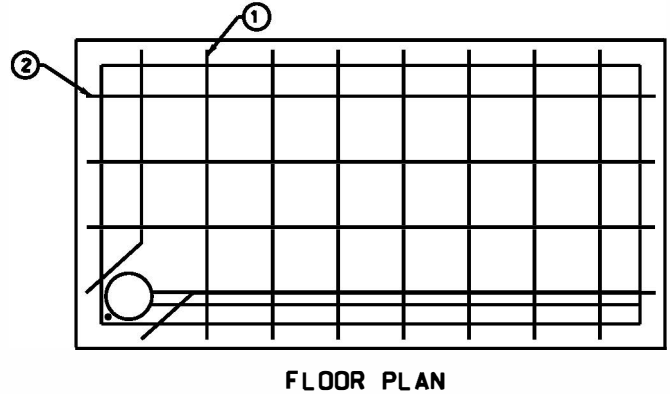


LOCATION	FLOOR		WALLS																			
STOCK NO.																						
DEPTH = H			6'-6"				7'-0"				8'-0"				9'-0"				10'-0"			
ROD NO.	①	②	③	④	⑤	⑥	③	④	⑤	⑥	③	④	⑤	⑥	③	④	⑤	⑥	③	④	⑤	
QUANTITY	5	4	8	8	10	10	8	8	10	10	8	8	12	12	8	8	16	16	8	8	18	
SIZE	#3	#3	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	
C/C	18"	18"	18"	18"	18"	18"	15"	18"	18"	18"	18"	18"	18"	18"	18"	18"	15"	15"	18"	18"	15"	
LENGTH	5'-6"	7'-0"	6'-9"	6'-9"	5'-6"	7'-0"	7'-3"	7'-3"	5'-6"	7'-0"	8'-3"	8'-3"	5'-6"	7'-0"	9'-3"	9'-3"	5'-6"	7'-0"	10'-3"	10'-3"	5'-6"	

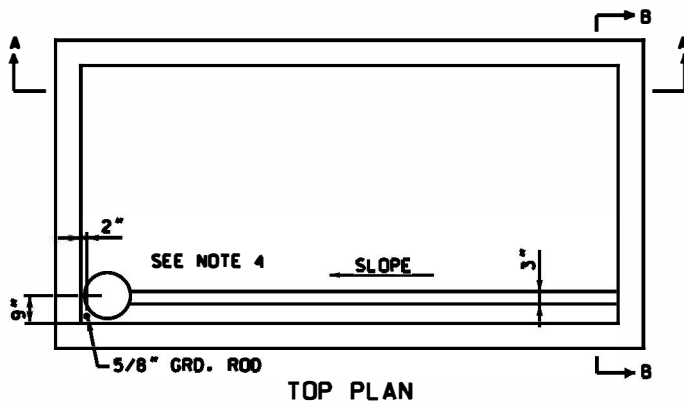

NOTES:

- C = ROWY. ----- 21"
- = FLUSH SDWR. ----- 6"
- = RECESSED SDWR. --- 18"

2. JOB INSTRUCTIONS WILL DIRECT WHICH ROOF IS TO BE USED.
3. ASSEMBLY STOCK # 9700-2175
4. INSTALL SUMP PUMP PIT, GROUND ROD, AND GUTTER IN MANHOLE PER DWG'S 4-2-1060 AND 4-2-1096. FOR TRANSFORMER MANHOLES, INSTALL SUMP PUMP ON L.V. END.
5. THIS DWG SUPERSEDES DWG 2-2-0685 & 0686, DATED 9-4-59
6. REV A: CHANGED DWG FORMAT; CHANGED STOCK NO'S PER WMIS.

CONCRETE SCHEDULE	
FLOOR	13 CU. FT.
WALLS	16 CU. FT. PER VERT. FT.

DRAWN: LKD | DVLPEO: CEG | DATE: 1/13/78 | REVIEWED: RDS | DATE: 08/26/15 | APPRVD: AAT | DATE: 08/26/15 | NEXT REVIEW: 08/19 | REV: A



DISTRIBUTION
STANDARDS

4'-6" x 6'-0"
ROADWAY MANHOLE