


PLAN VIEW

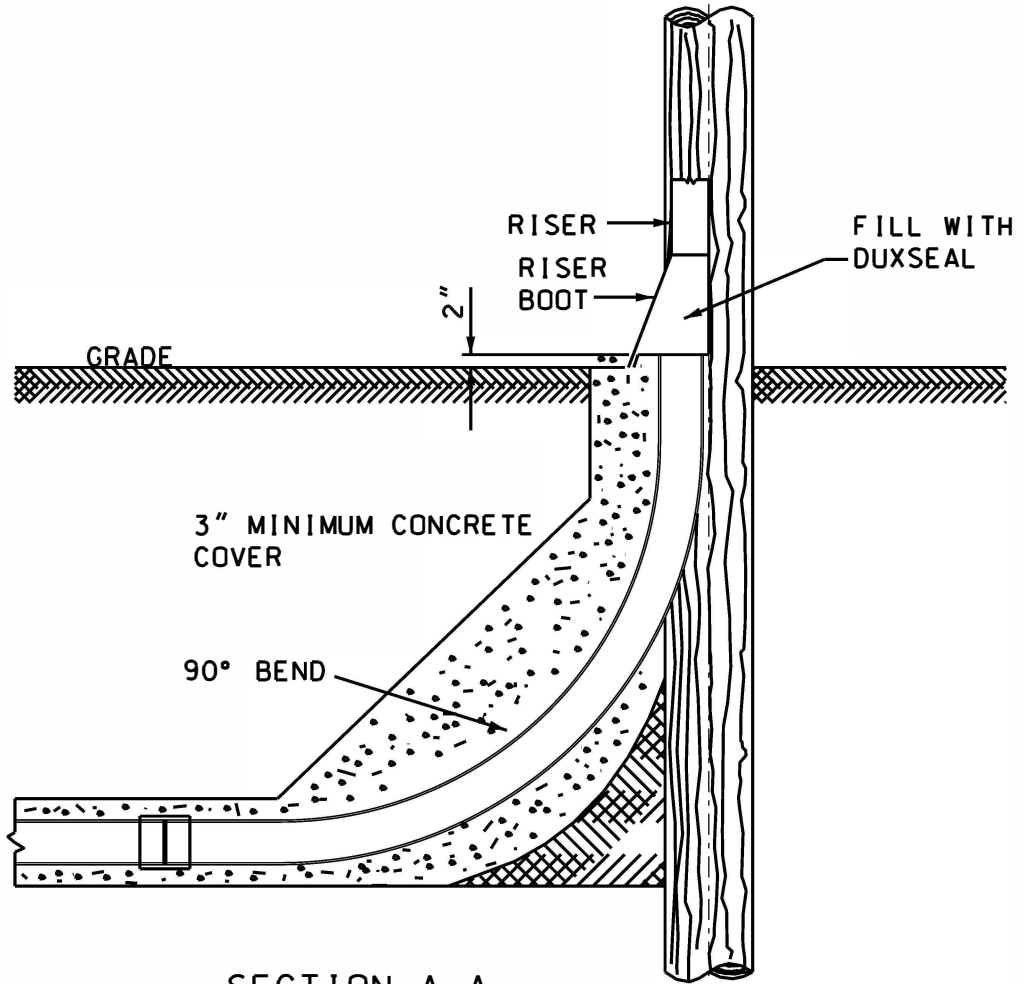

SECTION A-A

**NOTES:**


1. CONDUIT DEPARTMENT WILL PLUG DUCT IF RISER IS NOT INSTALLED IMMEDIATELY.
2. CUSTOMER OR CUSTOMER CONTRACTOR EXCAVATING WITHIN FIVE FEET OF A PEPSCO OWNED POLE SHALL PERFORM THE WORK UNDER PEPSCO SUPERVISION.
3. SEE PAGE 2 FOR ACCEPTABLE SWEEP BEND INSTALLATION.

DRAWN: DPJ	DVLPEO: TC	DATE: 9-1-61	REVIEWED: RDS	DATE: 9/1/15	APPRVD: AAT	DATE: 9/1/15	NEXT REVIEW: 9/19	REV: B
------------	------------	--------------	---------------	--------------	-------------	--------------	-------------------	--------



POWER  
DISTRIBUTION  
STANDARDS

POLE RISER SHIELD U.G. TO O.H.  
CONNECTION ASSEMBLY CONSTRUCTION

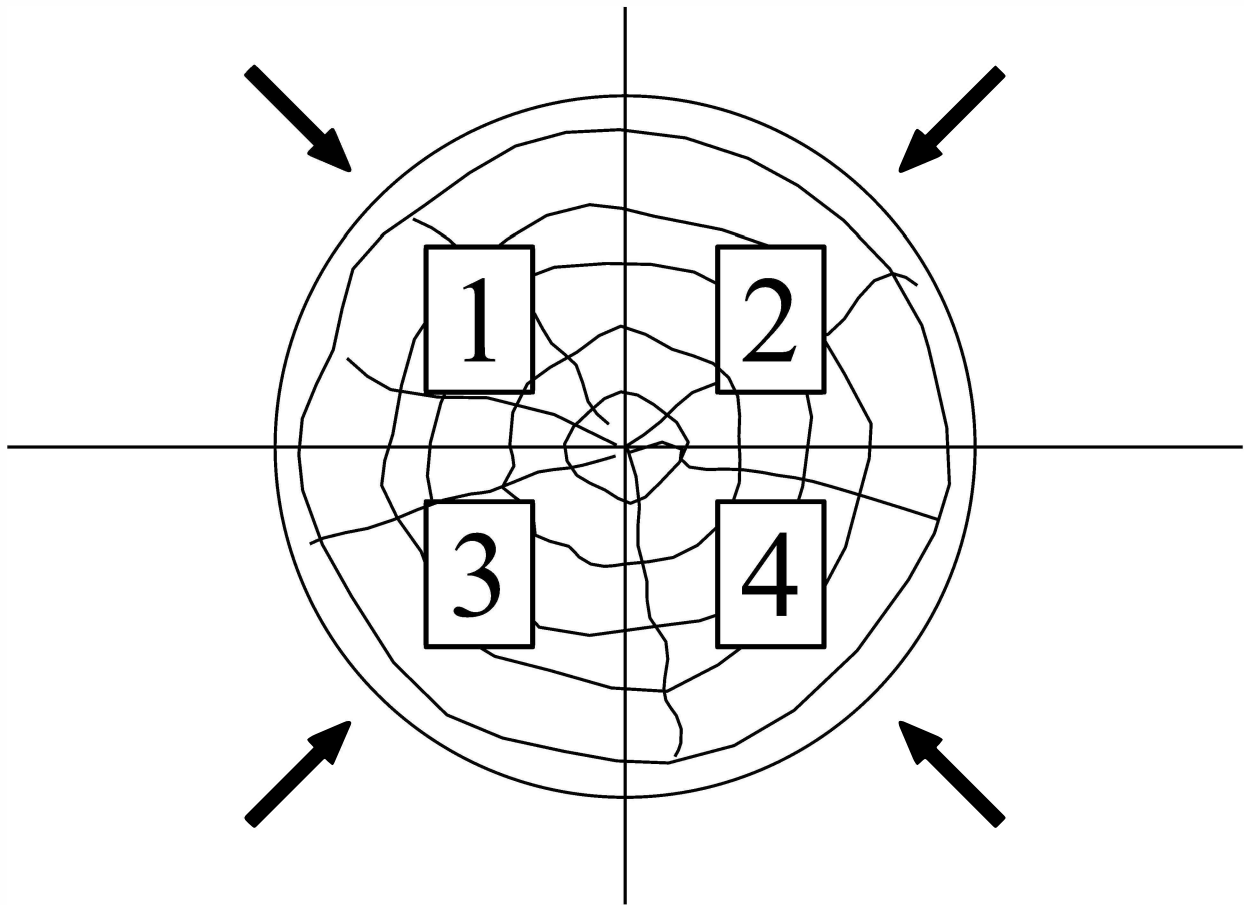

---

ROAD

<<<<<< Traffic Direction

---

DRAWN: DPJ | DVLPEO: TC | DATE: 9-1-61 | REVIEWED: RDS | DATE: 9/1/15 | APPRVD: AAT | DATE: 9/1/15 | NEXT REVIEW: 9/19 | REV: B



POWER  
DISTRIBUTION  
STANDARDS

OVERHEAD REFERENCE FOR  
SWEEP BEND INSTALLATION