


METER INSTALL FOR 265/460V 200 AMP OR LESS

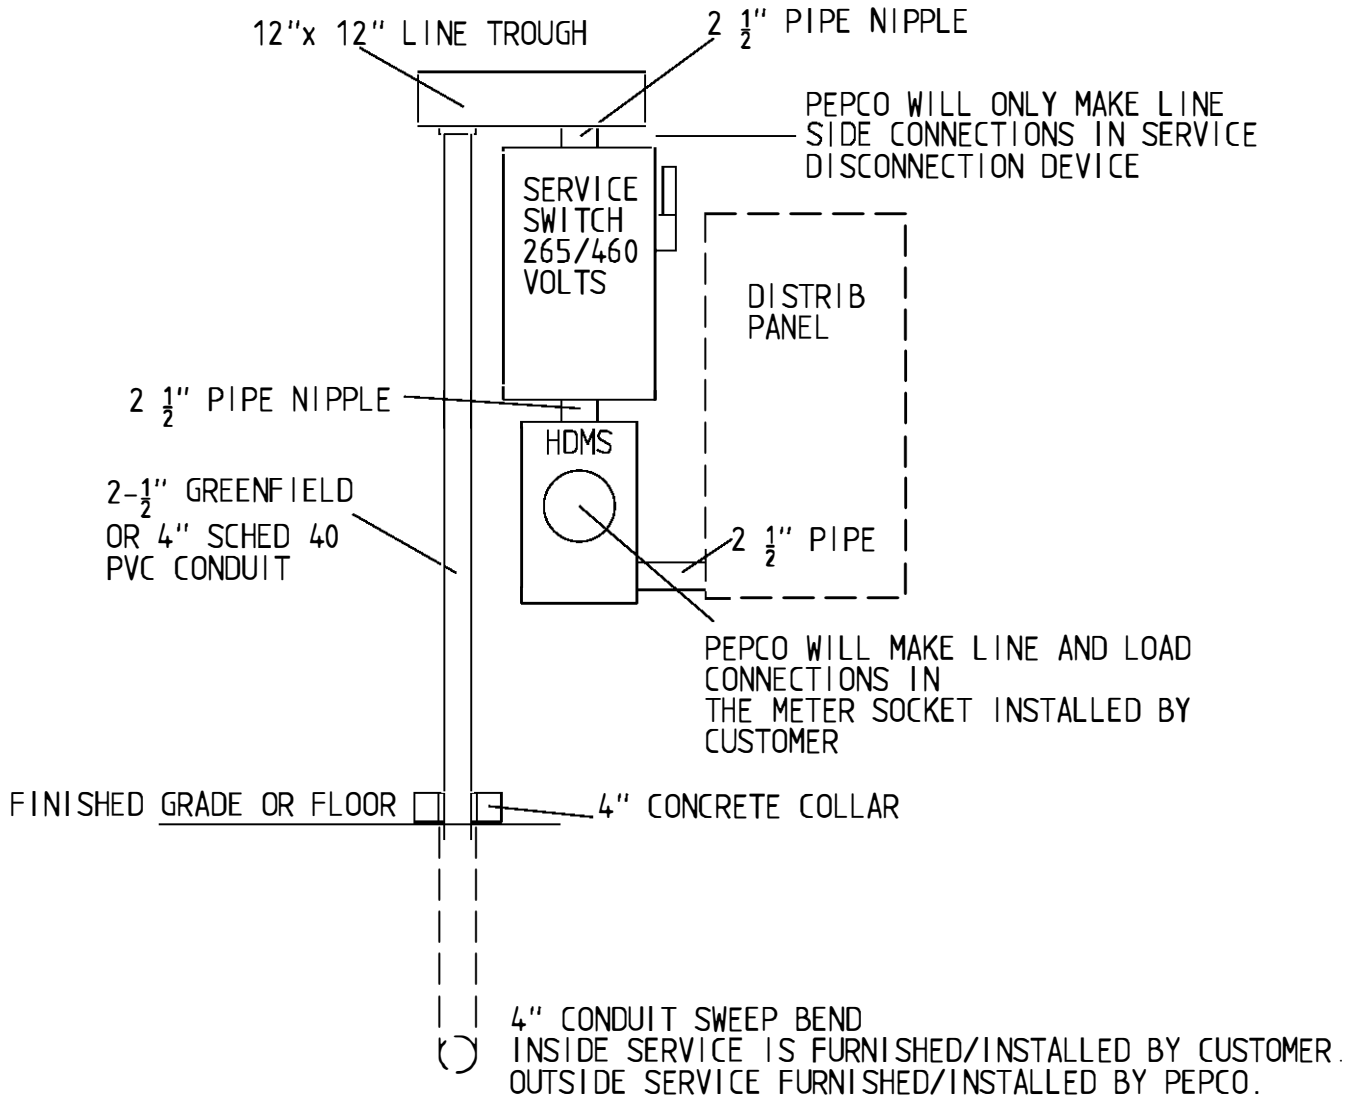

NOTES:

- *SEE DRAWING 1104 FOR ALTERNATIVE CABLE CONNECTION.
- *TROUGH SHALL HAVE KNOCKOUT FOR 2 1/2" CONNECTOR.
- *2 1/2" GREENFIELD CONNECTOR FURNISHED AND INSTALLED BY PEPCO.
- *INCOMING SERVICE CABLES FURNISHED AND INSTALLED BY PEPCO UP TO LINE SIDE OF THE SERVICE SWITCH.
- *ALL OTHER EQUIPMENT NOT NOTED AS BEING FURNISHED OR INSTALLED BY PEPCO WILL BE THE RESPONSIBILITY OF THE CUSTOMER.

REV: A	DESCRIPTION: CONVERSION FROM CD.003.01.	ACE: <input type="checkbox"/>	DPL: <input type="checkbox"/>	PEPCO: <input checked="" type="checkbox"/>
DEVELOPED: BAM	DATE: 04/26/1982	REVIEWED: RDS	DATE: 10/13/2015	APPROVED: BS
		DATE: 06/15/2018		

METER INSTALL FOR 265/460V 200 AMP OR LESS

