


TOP VIEW

REINFORCING SCHEDULE		
ROD NO.	1	2
QUANTITY	8	16
ROD SIZE	#4	#3
LENGTH	4'-0"	4"
C/C	3"	12"

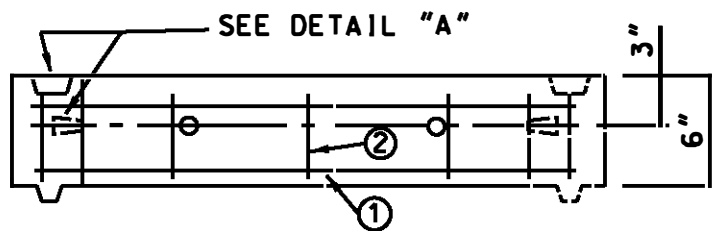


FRONT VIEW

NOTES:

1. THIS DEVICE IS FOR FUTURE ADJUSTMENT TO GRADE. DO NOT USE IN PVD. SDWK.
2. REFER TO DWG 4-2-1084 FOR DETAIL OF URD 3.5' X 3.5' RECTANGULAR CASING.
3. REFER TO DWG. 4-2-1129 FOR 3.5' X 3.5' SDWK. ROOF.
4. STOCK #9721-0767 APPROX. WT. 384 LBS. COMP UNIT MHER3535MB
5. IN ROADWAY INSTALATIONS USE THE BILCO RDWY DOOR STOCK NO. 9721-0686 AS THE ROOF AND ADJUST IT TO GRADE.
6. USE 4000 PSI MINIMUM STRENGTH CONCRETE.
7. REV A: CHANGED DWG FORMAT AND CHANGED STOCK NO'S PER WMIS.

1/2" 13 X 2"
NON-CORROSIVE
INSERTS STOCK
NO. 9725-0808

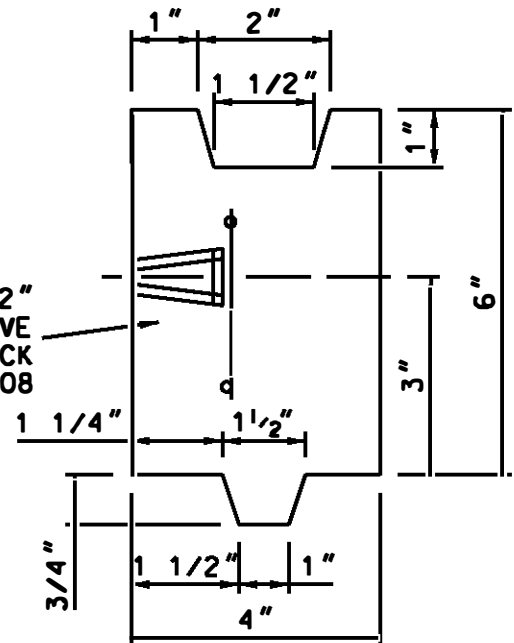

DETAIL "A"

DRAWN: AVI | DVLPEP: RAC | DATE: 12-12-78 | REVIEWED: RDS | DATE: 09/01/15 | APPRVD: AAT | DATE: 09/01/15 | NEXT REVIEW: 09/19 | REV: A



POWER
DISTRIBUTION
STANDARDS

6" EXTENSION RING 3.5' X 3.5'
URD RECTANGULAR CASING